

LOCATION 3507 ARAGLIN DR

CITY GASTONIA

BETWEEN _____ STREET & _____ STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>3/4</u>	<u>P</u>	<u>37'</u>	<u>12-14-99</u>		
MAIN TO PROP LINE	<u>1"</u>	<u>1"</u>	<u>61'</u>			
PROP LINE TO BLDG	<u>1"</u>	<u>1"</u>	<u>31'</u>			

ENTERS 3507

BRANCHED INTO

TAP SIZE 1/2" PRESSURE _____ PSI _____ INCHES W C LOCATION 20' S. of C of


PRESSURE TEST 100 PSI FOR 1/2 HRS BY GP Heathstone

MAIN SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1999

DEPTH 3 FT 0 IN LOCATION _____

"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS _____

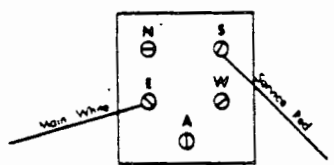

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>GP</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>I</u>	