

LOCATION 2442 ACAPULCO D.CITY EastonBETWEEN Sunset

STREET &

STREET

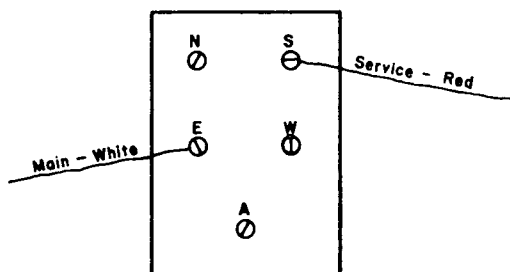
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4	ϕ	12'		24' of 3/4" C.I.W	
MAIN TO PROP. LINE	3/4	ϕ	0'		11-14-95	
PROP. LINE TO BLDG.	3/4	ϕ	12'			

ENTERS: 2442 1/2BRANCHED INTO: 2442TAP SIZE: 3/8PRESSURE 20 P.S.I. _____ INCHES W.C.

LOCATION

PRESSURE TEST: @ 100 psi For 1 1/4 Hrs. By EFMAIN-SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED _____DEPTH: 2 Ft. 0 In. LOCATION"A" P/S READING .6 TOTAL ANODES 1# 1 17# _____ L.R. # _____

REMARKS:

P.S. Reading #2432 - 1.2

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	plastic
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY