

LOCATION 406 Arthur St CITY Canton
BETWEEN Clyde STREET & S. York Rd STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>28'</u>			
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>2'</u>		<u>9-26-26</u>	
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>26'</u>			

ENTERS: 406 BRANCHED INTO: 0
TAP SIZE: 1" Sec PRESSURE 20 P.S.I. INCHES W.C. LOCATION

PRESSURE TEST: @ 105 psi For 44 Hrs. By EP
MAIN-SIZE 1" C.I. BARE STEEL ☒ COATED STEEL PLASTIC YEAR INSTALLED
DEPTH: 2 Ft. 6 In. LOCATION

"A" P/S READING .6 TOTAL ANODES I* 0 I7* 0 L.R. #

REMARKS:
NO Anode Installed All Bare pipe to be Retired & Renewed, Bare main project.

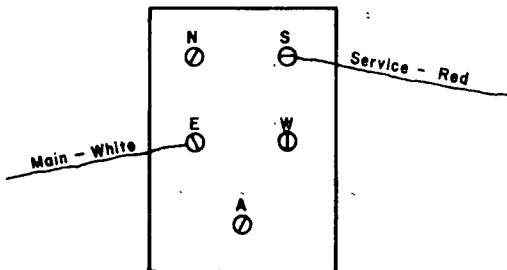

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>None</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY