

LOCATION 3007 Audrey Dr. CITY Gastonia
 BETWEEN Ridgeway Dr. STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	REPAIRED	RENEWED
Serv. main TO BLDG.	3/4	P	84'	8-7-87	Relocated	Service
Serv. main TO PROP LINE	3/4	P	4'		Added 14' of New p. pipe.	
PROP LINE TO BLDG.	3/4"	P	80'		Tested 100# 1/4 hr.	

ENTERS 3015 Audrey Dr. BRANCHED INTO 3007 Audrey 2-14-00
 TAP SIZE 3/4" PRESSURE 100 PSI INCHES W.C. LOCATION 64' East of


Audrey Dr.
 PRESSURE TEST. @ 100# PSI FOR 1/4" HRS BY BB

Serv. ~~main~~ SIZE 3/4" C.I. BARE STEEL COATED STEEL PLASTIC ✓ YEAR INSTALLED 2000

DEPTH: 2 FT 6 IN. LOCATION 318' South of Ridgeway Dr

"A" P/S READING plastic TOTAL ANODES 1# — 17# — L.R. # —

REMARKS
Relocated Plastic Service.

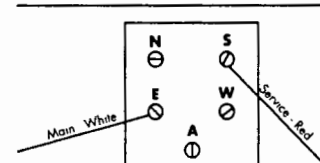

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	P.R.S.R
P/S Pipeline Lead - White Existing Main	E	