

LOCATION 316 S. AVONCITY GastoniaBETWEEN 2ndSTREET & 3rd

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>48'</u>	<u>9-11-93</u>	<u>tid over 22' of P. Sw.</u>	
MAIN TO PROP. LINE					<u>to Ext P. main</u>	
PROP. LINE TO BLDG.						


ENTERS: 316

BRANCHED INTO:

TAP SIZE:	PRESSURE _____ P.S.I. _____ INCHES W.C.	LOCATION <u>13' W of C of</u> <u>S. AVON</u>
-----------	---	---

PRESSURE TEST: @ 100 psi For 1/4 Hrs. By SPMAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1993DEPTH: 3 Ft. 0 In. LOCATION _____"A" P/S READING P TOTAL ANODES 1* _____ 17* _____ L.R. # _____

REMARKS:

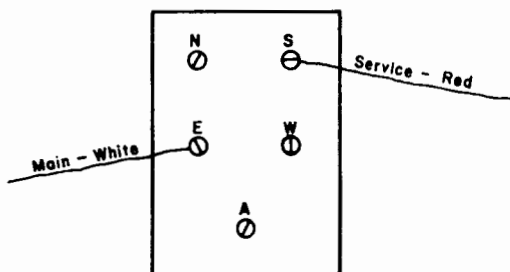

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>R</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY