

LOCATION 407 + 409 S. Avon St. CITY Gastonia
BETWEEN 3rd Ave STREET & Maple St. STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>15'</u>	<u>8-21-93</u>	<u>Tied over 38'</u>	<u>Existing 3/4 C/W</u>
MAIN TO PROP. LINE					<u>ON 409</u>	<u>Tied over 56'</u>
PROP. LINE TO BLDG.					<u>ON 407</u>	<u>Existing 3/4 C/W</u>


ENTERS: 409 BRANCHED INTO: 407
TAP SIZE: 1/2 PRESSURE 600 P.S.I. _____ INCHES W.C. LOCATION 227' S of C of 3rd Ave.

PRESSURE TEST: @ 100 psi For 1/4 Hrs. By RL
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1993
DEPTH: 3 Ft. 0 In. LOCATION 13' W of C of S. Avon St.

"A" P/S READING P TOTAL ANODES 1 * 1 17 * _____ L.R. # _____

REMARKS: Split Service

Bare Main Replacement
Program

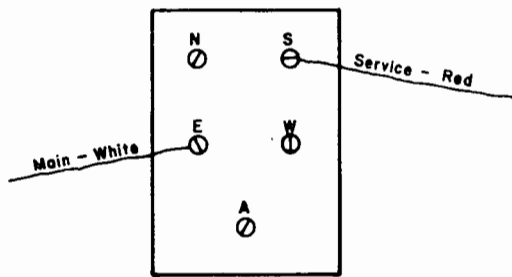

Test Station		ENG. DEPT. USE ONLY
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Riser 407 - 1.2</u> <u>Riser 409 - 1.2</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	