

LOCATION 3225 Brandywine CITY Columbia
BETWEEN Chapel Grove Rd. STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>D</u>	<u>115'</u>		<u>Retired 94' of 3/4" S/W Service</u>	
MAIN TO PROP. LINE	<u>3/4</u>	<u>D</u>	<u>3'</u>		<u>3-27-97</u>	
PROP. LINE TO BLDG.	<u>3/4</u>	<u>D</u>	<u>112'</u>			

ENTERS: 3221 BRANCHED INTO: 3225

TAP SIZE: 3/4 PRESSURE 60 PSI _____ INCHES W.C. LOCATION


PRESSURE TEST: @ 100 PSI FOR 14 HRS. BY ED

MAIN SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED _____

DEPTH: 2 FT. 6 IN. LOCATION

"A" P/S READING 1.3 TOTAL ANODES 1# 0 17# 0 L.R. # _____

REMARKS:

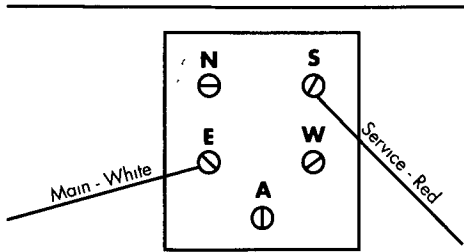

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY