


LOCATION 2012 CAROL Dr.CITY CastrovilleBETWEEN LindaSTREET & DAMELA

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>0'</u>	<u>Tied Ext 3/4 C.W Service Over</u>		
MAIN TO PROP. LINE				<u>to New 3/4 Plastic Service IN</u>		
PROP. LINE TO BLDG.				<u># 2028</u>	<u>10-9-95</u>	

ENTERS: 2028BRANCHED INTO: 2012TAP SIZE: 3/4 Ser. PRESSURE 20 P.S.I. \_\_\_\_\_ INCHES W.C. LOCATION \_\_\_\_\_PRESSURE TEST: @ 100 psi For 44 Hrs. By EPMAIN-SIZE 3/4 C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1995DEPTH: 2 Ft. 0 In. LOCATION \_\_\_\_\_"A" P/S READING P TOTAL ANODES 1\* 1 17\* \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

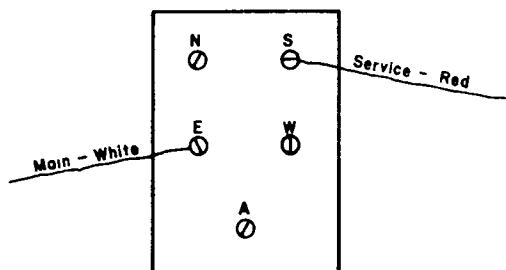

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>Riser</u>	<u>1.3</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY