

LOCATION 307 Carpenter St. CITY Castroville

BETWEEN Warren St STREET @ Dead End STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>70'</u>	<u>8-19-95</u>		
MAIN TO PROP. LINE	<u>3/4"</u>	<u>P</u>	<u>5'</u>			
PROP. LINE TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>65'</u>			

ENTERS: 307 BRANCHED INTO:

TAP SIZE: 1/2 PRESSURE 60 P.S.I. _____ INCHES W.C. LOCATION 1409' S. of center of

Warren St


PRESSURE TEST: @ 100 psi For 1/4 Hrs. By S. Hoffstetter

MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1995

DEPTH: 3 Ft. 0 In. LOCATION 14' W. of center of Carpenter St.

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 L.R. # 397807

REMARKS:

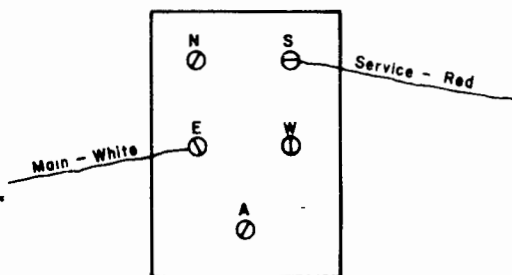

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY