

LOCATION 314 S. Church

CITY Gaslonis

BETWEEN Edwards Ln

STREET & 2nd Rd

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4	P	1'	4-9-94	tie 64' Serv. W. to	
MAIN TO PROP. LINE					Ext 2" P main	
PROP. LINE TO BLDG.						

ENTERS: 314

BRANCHED INTO: —

TAP SIZE: 1/2

PRESSURE

P.S.I.

INCHES W.C.

LOCATION 17' E. of cap

S. Church


PRESSURE TEST: @ 100 psi For 1/4 Hrs. By SP

MAIN-SIZE 2" C.I. — BARE STEEL — COATED STEEL — PLASTIC ☒ YEAR INSTALLED 1992

DEPTH: 3 Ft. 0 In. LOCATION

"A" P/S READING P TOTAL ANODES 1# — 17# — L.R. # —

REMARKS: tie wire off at Main

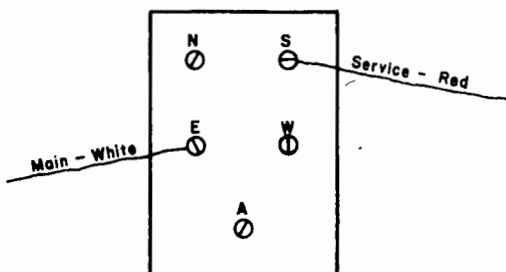

Test Station

ENG. DEPT. USE ONLY

Reading & Location

Lead

Volts

P/S Pipeline Lead - Red
New Service

OR

, 900

P/S Pipeline Lead - White
Existing Main

E