

LOCATION 935 Church Hill Dr. CITY Gast.  
BETWEEN Carmen Dr. STREET & Wilkins St. STREET

|                     | SIZE        | TYPE      | LENGTH     | INSTALLED | RETIRED | RENEWED        |
|---------------------|-------------|-----------|------------|-----------|---------|----------------|
| MAIN TO BLDG.       | <u>3/4"</u> | <u>P.</u> | <u>77'</u> |           |         | <u>11-4-97</u> |
| MAIN TO PROP. LINE  | <u>"</u>    | <u>"</u>  | <u>4'</u>  |           |         |                |
| PROP. LINE TO BLDG. | <u>"</u>    | <u>"</u>  | <u>73'</u> |           |         |                |


ENTERS: Same BRANCHED INTO:  
TAP SIZE: 3/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION 390' From @ OF  
Carmen St.

PRESSURE TEST: @ 60 PSI FOR 1/4 HRS. BY D.F.  
MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ✓ YEAR INSTALLED 1997

DEPTH: 3 FT. 0 IN. LOCATION W.O.F. Church Hill

"A" P/S READING P. TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

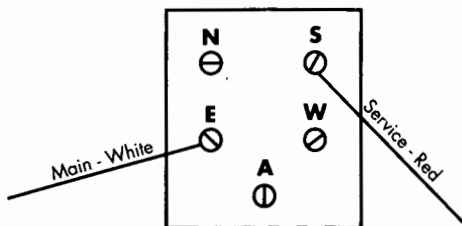

| Test Station                               |          |       |
|--|----------|-------|
| Reading & Location                         | Lead     | Volts |
| P/S Pipeline Lead - Red<br>New Service     | <b>S</b> |       |
| P/S Pipeline Lead - White<br>Existing Main | <b>E</b> |       |

ENG. DEPT. USE ONLY