

LOCATION 900 Cloister Dr. CITY Groton, CT
BETWEEN Augusta Dr STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>5/8"</u>	<u>P</u>	<u>104'</u>			<u>1-22-03</u>
MAIN TO PROP LINE	<u>5/8"</u>	<u>P</u>	<u>0</u>			
PROP LINE TO BLDG	<u>5/8"</u>	<u>P</u>	<u>104'</u>			

ENTERS 900 BRANCHED INTO
TAP SIZE 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION 6' N. of center of Cloister Dr.


PRESSURE TEST @ 100 PSI FOR 1/4 HRS BY S-66

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED _____

DEPTH 3 FT 0 IN LOCATION 56' NE. of center of Cut-Dr - SW

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR # 30004

REMARKS

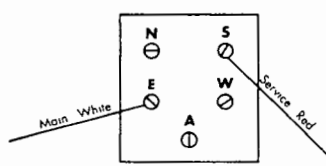

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	
P/S Pipeline Lead - White Existing Main	<u>E</u>	