

LOCATION 1297 Creekview DR. CITY GASTON, N.C.
 BETWEEN Candlewood DR. STREET & Shady Oak TRL. STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	3/4"	P	90'	7-24-00		
MAIN TO PROP LINE	3/4"	P	10'			
PROP LINE TO BLDG	3/4"	P	80'			

ENTERS 1297 BRANCHED INTO
 TAP SIZE 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION 210' S. of center of Shady Oak TRL.


PRESSURE TEST @ 100 PSI FOR 1/4 HRS BY S.H.

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 1997

DEPTH 3 FT 0 IN LOCATION 14' E. of center of Creekview DR.

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR # 642294

REMARKS

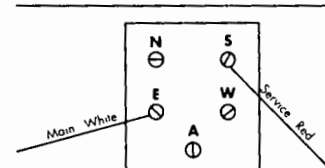

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead Red New Service	S	
P/S Pipeline Lead White Existing Main	E	