

LOCATION 842 S. Dalton CITY Castroville  
BETWEEN 10th STREET & 19th STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>4'</u>	<u>11-5-94</u>	<u>Tied over 158' of</u>	
MAIN TO PROP. LINE					<u>3/4" CW to ext 2" Plastic</u>	
PROP. LINE TO BLDG.					<u>MAN</u>	

ENTERS: 842 S. Dalton BRANCHED INTO: 1019 W 10th  
TAP SIZE: 1/2 PRESSURE 60 P.S.I. \_\_\_\_\_ INCHES W.C. LOCATION \_\_\_\_\_

PRESSURE TEST: @ 100 psi For 14 Hrs. By E Perry  
MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1994  
DEPTH: 4 Ft. 0 In. LOCATION \_\_\_\_\_

"A" P/S READING P TOTAL ANODES 1\* 1 17\* \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: Tie over pipe tied off at main

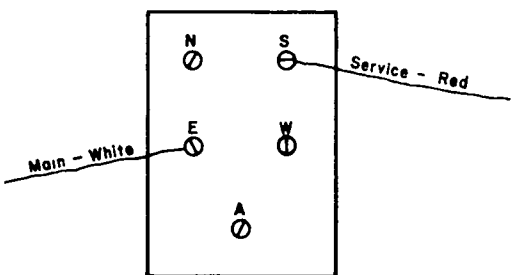

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>R/Soc.</u>	<u>1.0</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY