

LOCATION 130 + 156 Dixon Cir.

CITY Gastonia

BETWEEN S. Marietta St.

STREET & Oak Valley Dr.

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.						
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						

ENTERS:

BRANCHED INTO:


TAP SIZE:	PRESSURE _____ PSI	_____ INCHES W.C.	LOCATION
-----------	--------------------	-------------------	----------

PRESSURE TEST: @ _____ PSI FOR _____ HRS. BY _____

 MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1960
DEPTH: 3' FT. Ø IN. LOCATION Dixon Cir.
 "A" P/S READING 990 TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS: 130 Dixon Cir. Bonded insulator on 3/4" C&W service line which comes off of existing 3/4" C&W service at 156 Dixon Cir. C.P. #1845 / Readings: .565 before bond and .760 after bond was made.

156 Dixon Cir. Bonded 3/4" C&W service toe to 2" C&W gas main. Also cleared a water line "choke" on the 3/4" C&W gas service. / Readings: .700 before bond and .950 after bond was made and "choke" was cleared. C.P. #1845

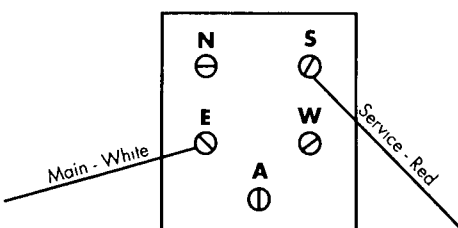

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY