

LOCATION 286 Dixon Cir. CITY Gastonia
BETWEEN Dixon Cir. [100 Block] STREET & S. Marietta St. STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.						
MAIN TO PROP. LINE						
PROP. LINE TO BLDG.						


ENTERS: _____ BRANCHED INTO: _____
TAP SIZE: _____ PRESSURE _____ PSI _____ INCHES W.C. LOCATION _____

PRESSURE TEST: @ _____ PSI FOR _____ HRS. BY _____
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1960
DEPTH: 3' FT. 0 IN. LOCATION Dixon Cir. [100 Block]

"A" P/S READING 1.100 TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS: Installed 1-16 mmw to 3/4" C+W isolated service line. C.P. # 1845.

Readings: .644 before mmw was installed and 1.280 after mmw was installed to 3/4" C+W I/S service line.

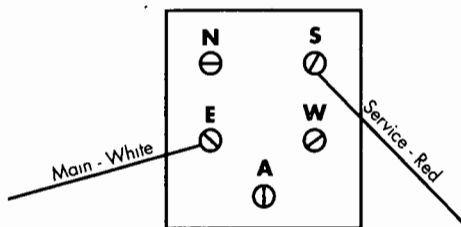

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY