

LOCATION 912 & 910 S Deguard CITY Castroville
BETWEEN 8th STREET & 9th STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>143</u>			
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>40</u>			<u>6-13-94</u>
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>103</u>			

ENTERS: 912 BRANCHED INTO: 910

TAP SIZE: 3/4 50r. PRESSURE 20 P.S.I. _____ INCHES W.C. LOCATION _____

PRESSURE TEST: @ 100 psi For 1 1/2 Hrs. By EP


MAIN-SIZE 1 1/2 C.I. _____ BARE STEEL X COATED STEEL _____ PLASTIC _____ YEAR INSTALLED 1958

DEPTH: _____ Ft. _____ In. LOCATION _____

"A" P/S READING 0.5 EXT 1 1/2 Bare Main TOTAL ANODES 1* 1 17* 1 L.R. # _____

REMARKS:

Tied EXT 3/4 GWS Service over to New 3/4 Plastic Service

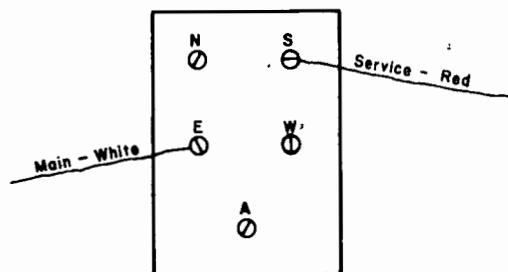

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>New Service</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY

P - #912
EXT 3/4 GWS Ser. 1.3 - #910