

LOCATION 300 Eleventh Ave.CITY East.BETWEEN Hillside Dr.

STREET &amp;

Edgewood C.C.

STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P.</u>	<u>3' TIEOVER.</u>		<u>4.</u>	<u>9-92</u>
MAIN TO PROP. LINE	<u>"</u>	<u>"</u>				
PROP. LINE TO BLDG.	<u>"</u>	<u>"</u>				

ENTERS: SAMP

BRANCHED INTO:

TAP SIZE: 3/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W C LOCATION 116' from A of Hillside Dr.PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY AWMAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1996DEPTH: 3 FT. 0 IN. LOCATION Southside of Eleventh Ave."A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

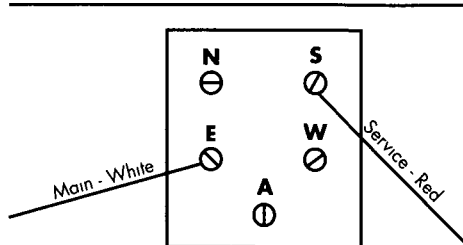

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<b>S</b>	
P/S Pipeline Lead - White Existing Main	<b>E</b>	

ENG. DEPT. USE ONLY