

LOCATION 1909 & 1910 E. ELM ST CITY Easton
BETWEEN Grove STREET & Deadend STREET

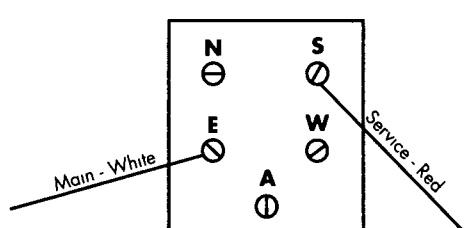
| | SIZE | TYPE | 1910 LENGTH 1909 | | INSTALLED | RETIRED | RENEWED |
|---------------------|------------|------------|------------------|-------------|-----------------------------|---------------|--------------------|
| MAIN TO BLDG. | <u>3/4</u> | <u>clw</u> | <u>73'</u> | <u>128'</u> | <u>Bonded Dresser's for</u> | | <u>C.P. System</u> |
| MAIN TO PROP. LINE | | | | | | <u>7-7-98</u> | |
| PROP. LINE TO BLDG. | | | | | | | |

ENTERS: 1909 & 1910 BRANCHED INTO: 1908
TAP SIZE: 3/4 PRESSURE 60 PSI _____ INCHES W C LOCATION _____

PRESSURE TEST: @ _____ PSI FOR _____ HRS BY S.E
MAIN-SIZE 3/4 Pl. Sa C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ☒ YEAR INSTALLED 7-7-98
DEPTH: 1 FT 6 IN LOCATION _____

"A" P/S READING 1.0 TOTAL ANODES 1# 1 17# _____ L.R. # _____

REMARKS: This DRAWING is just to show amount of 3/4 clw being protected
And location of dresser couplings (201' of 3/4 clw pipe) Isolated services due
being protected to tie-over to Pl. Sa
(1st Reading .6 - After Dressers bonded And Anode Added C.P. 1.0)

|  | Test Station | | | ENG. DEPT. USE ONLY |
|--|--|---------------|------------|---------------------|
| | Reading & Location | Lead | Volts | |
| | P/S Pipeline Lead - Red New Service | <u>Risers</u> | <u>1.0</u> | |
| | P/S Pipeline Lead - White Existing Main | <u>E</u> | | |

1909 & 1910
E. ELM ST