

LOCATION 1500 & 1501 Fern Forest DR CITY GASTONIA * NOT ON 4/12 ISOLATED UST

BETWEEN Suprise DR STREET & Woodvale Ave STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>CLW</u>		<u>2-24-99</u>		
MAIN TO PROP. LINE				<u>Bonded Dresson to</u>		<u>2" clw</u>
PROP. LINE TO BLDG.						<u>main</u>

ENTERS: BRANCHED INTO: ☒

TAP SIZE. 5/8 PRESSURE _____ PSI _____ INCHES W.C. LOCATION _____

PRESSURE TEST. @ _____ PSI FOR _____ HRS. BY _____

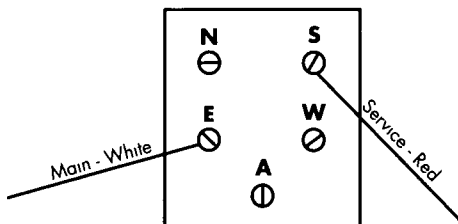
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1961

DEPTH: 2 FT 0 IN LOCATION _____

"A" P/S READING 1500-1500 TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS: # 1501-1300

Bonded Dresson's to 2" clw main

	Test Station			ENG. DEPT. USE ONLY
	Reading & Location	Lead	Volts	
	P/S Pipeline Lead - Red New Service	<u>Riser</u>	<u>1500</u> <u>1501</u>	
	P/S Pipeline Lead - White Existing Main	<u>E</u>		

AS 1500
P.S. 1300