

LOCATION 2515 Firehawk Ct. CITY GA Starke
BETWEEN TEA Olive Dr. STREET & STREET

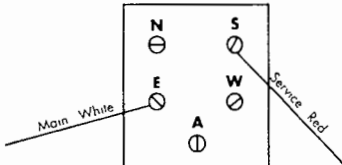
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>518'</u>	<u>P</u>	<u>38'</u>	<u>2-14-02</u>		
MAIN TO PROP LINE	<u>518'</u>	<u>P</u>	<u>3'</u>			
PROP LINE TO BLDG	<u>518'</u>	<u>P</u>	<u>35'</u>			

ENTERS 2515 BRANCHED INTO
TAP SIZE 3/4" PRESSURE 60 PSI INCHES W C LOCATION 619'E. of center of
TEA Olive Dr.

PRESSURE TEST @ 100 PSI FOR 1 1/4 HRS BY S.C.H.
MAIN SIZE 2" C I BARE STEEL COATED STEEL PLASTIC ☒ YEAR INSTALLED 2000
DEPTH 3 FT 0 IN LOCATION 18'S. of center of Firehawk Ct.

"A" P/S READING P TOTAL ANODES 1# 0 17# 0 LR # 33645

REMARKS

	Test Station		
	Reading & Location	Lead	Volts
	P/S Pipeline Lead - Red New Service	<u>S</u>	
	P/S Pipeline Lead - White Existing Main	<u>E</u>	