

LOCATION 2110 Flint Ln CITY Gasl.
BETWEEN PAYSOUR St. STREET & Deadend STREET


| | SIZE | TYPE | LENGTH | INSTALLED | RETIRED | RENEWED |
|--------------------|-------------|----------|------------|-----------|-----------|-------------|
| MAIN TO BLDG. | <u>3/4"</u> | <u>P</u> | <u>32'</u> | | <u>10</u> | <u>8-97</u> |
| MAIN TO PROP. LINE | <u>"</u> | <u>"</u> | <u>16'</u> | | | |
| PROP LINE TO BLDG. | <u>"</u> | <u>"</u> | <u>16'</u> | | | |

ENTERS SAME BRANCHED INTO:
TAP SIZE: 3/4" PRESSURE 60 PSI _____ INCHES W.C. LOCATION 265' From @ of
PAYSOUR St.

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY D.F.
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1997
DEPTH: 3 FT 0 IN. LOCATION S. of Flint St.

"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS:

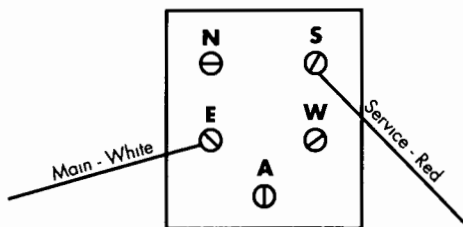

| Test Station | | |
|--|----------|-------|
| Reading & Location | Lead | Volts |
| P/S Pipeline Lead - Red New Service | S | |
| P/S Pipeline Lead - White Existing Main | E | |

ENG. DEPT. USE ONLY