

LOCATION 101 Gamble Ave CITY Castroville
BETWEEN Bright STREET & Edgewood Rd STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>9w</u>	<u>8'</u>	<u>Relocated</u>		
MAIN TO PROP. LINE				<u>7-13-55</u>		
PROP. LINE TO BLDG.						

ENTERS: 101 BRANCHED INTO: 105
TAP SIZE: 3/4 sec. PRESSURE 60 P.S.I. _____ INCHES W.C. LOCATION _____

PRESSURE TEST: @ 120 psi For 114 Hrs. By ED
MAIN-SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1972
DEPTH: 2 Ft. 6 In. LOCATION _____

"A" P/S READING 1.1 TOTAL ANODES 1# 017 # 0 L.R. # _____

REMARKS: _____

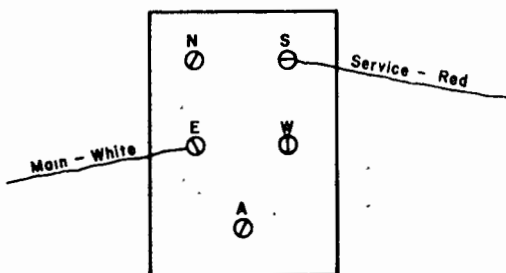

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u> <u>R/Son</u>	<u>1.1</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY