

LOCATION 3617 Golfview Dr. CITY Castroville

BETWEEN Kendrick STREET & STREET

| | SIZE | TYPE | LENGTH | INSTALLED | RETIRED | RENEWED |
|--------------------|------------|----------|------------|--------------------------|---------|---------|
| MAIN TO BLDG. | <u>3/4</u> | <u>P</u> | <u>58'</u> | <u>Relocated 8/27/98</u> | | |
| MAIN TO PROP LINE | | | | | | |
| PROP. LINE TO BLDG | | | | | | |

ENTERS 3617 BRANCHED INTO: 3612

TAP SIZE: 3/4 50" PRESSURE 60 PSI _____ INCHES W C LOCATION

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY EP

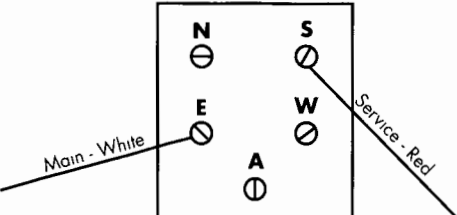
MAIN SIZE 3/4 C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED _____

DEPTH: 2 FT 0 IN LOCATION

"A" P/S READING 1.2 TOTAL ANODES 1# 0 17# 0 L.R. # _____

REMARKS:

Tinner wire bonded to EXT 3/4 GWS Ser.

|  | Test Station | | | ENG. DEPT. USE ONLY |
|--|--|----------|----------------------------|---------------------|
| | Reading & Location | Lead | Volts | |
| | P/S Pipeline Lead - Red New Service | <u>S</u> | <u>Riser Plastic - 1.2</u> | |
| | P/S Pipeline Lead - White Existing Main | <u>E</u> | | |