

LOCATION

3004 Hampton Cir

CITY

Castroville

BETWEEN

Kendrick Rd.

STREET &

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4"	P	64'	10-3-96		
MAIN TO PROP. LINE	3/4"	P	5'			
PROP. LINE TO BLDG.	3/4"	P	59'			

ENTERS:

3004

BRANCHED INTO:

TAP SIZE:

1/2

PRESSURE

60

P.S.I.

INCHES W.C.

LOCATION

248' NE. of center
of Kendrick Rd.

PRESSURE TEST: @

100 psi

For 44 Hrs.

By S. Guller

MAIN-SIZE 2"

C.I.

BARE STEEL

COATED STEEL

PLASTIC

YEAR INSTALLED

1978

DEPTH:

4 Ft.

0 In.

LOCATION

19' SE of center of Hampton Cir

"A" P/S READING

1.5

TOTAL ANODES 1#


0

17#

L.R. #

546548

REMARKS:

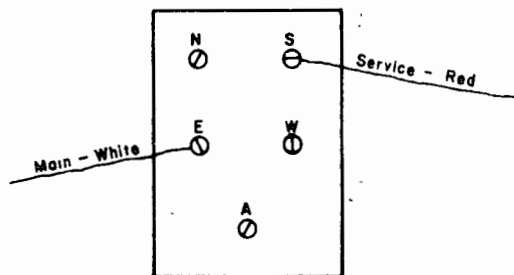

Test Station

ENG. DEPT. USE ONLY

Reading & Location

Lead

Volts

P/S Pipeline Lead - Red
New Service

S

P/S Pipeline Lead - White
Existing Main

E