

LOCATION 200 & 202 W. MARA ST CITY COLUMBIA

BETWEEN N. YORK STREET & STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>3/4</u>	<u>P</u>	<u>0'</u>	<u>Tied over 60' of C/C</u>		
MAIN TO PROP. LINE				<u>Pipe over to 5' x 3'4</u>		
PROP. LINE TO BLDG				<u>Discharge at # 204</u>		

TIED OVER
3/12/99

ENTERS: 204 BRANCHED INTO 200-202

TAP SIZE: 3/4 IN. PRESSURE 60 PSI INCHES W.C. LOCATION

PRESSURE TEST @ 100 PSI FOR 1/4 HRS BY ED


MAIN SIZE 3/4 C.I. BARE STEEL COATED STEEL PLASTIC ✓ YEAR INSTALLED 1999

DEPTH: 1 FT 6 IN LOCATION

A P/S READING 1.4 TOTAL ANODES 1# 1 17# LR #

REMARKS:

Isolated Service

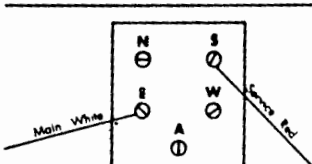

Test Station		
Reading & Location	Lead	Valis
P/S Pipeline Lead - Red	<u>R-#200</u>	<u>1.4</u>
New Service		
P/S Pipeline Lead - White	<u>R-#202</u>	<u>1.4</u>
Existing Main		

Posted to Computer Program
By VFM Date 6/9/99