

LOCATION 301 N Highland Street CITY GASTONIA
BETWEEN WALNUT STREET & RANKIN STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4"</u>	<u>P</u>	<u>26' New</u>	<u>Tied over</u>		
MAIN TO PROP. LINE			<u>(125' EXIST)</u>	<u>9-18-90</u>		
PROP. LINE TO BLDG.			<u>3/4" CW</u>	<u>orig inst</u>		

ENTERS: 301 BRANCHED INTO: 1969
TAP SIZE: 3/8 PRESSURE 60 PSI _____ INCHES W.C. LOCATION 11' south of Rankin

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY M Parker
MAIN-SIZE 4" C.I. _____ BARE STEEL _____ COATED STEEL X PLASTIC _____ YEAR INSTALLED 1955
DEPTH: 3 FT. 0 IN. LOCATION _____

"A" P/S READING 1.1 TOTAL ANODES 1# 1 17# _____ L.R. # _____

REMARKS: _____

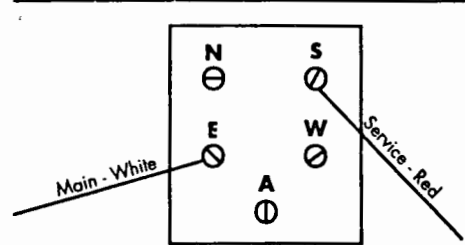

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>1.2 CW</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	<u>RISER</u>

ENG. DEPT. USE ONLY