

LOCATION 917 & 919 N. Highland CITY CAS.
BETWEEN DAVIDSON STREET & No. OUTLET STREET


	SIZE	TYPE	917 LENGTH	919 LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	3/4"	P	96'	28'		7-10-96	
MAIN TO PROP. LINE	"	"	36'	0			
PROP. LINE TO BLDG.	"	"	60'	28'			

ENTERS: 917 BRANCHED INTO: 919
TAP SIZE: 3/4" PRESSURE 600 PSI _____ INCHES W.C. LOCATION N. of 917
S. of 919

PRESSURE TEST: @ 100 PSI FOR 1 1/4 HRS. BY GK
MAIN-SIZE 2 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC _____ YEAR INSTALLED 96
DEPTH: 3 FT. IN. LOCATION E. side of N. Highland

"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS: _____

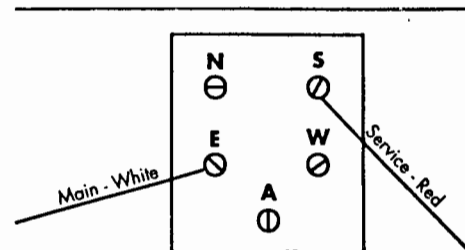

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	P
P/S Pipeline Lead - White Existing Main	E	

ENG. DEPT. USE ONLY