

LOCATION 1226 N. Highland CITY Castroville  
BETWEEN Cameron STREET & Dead End STREET

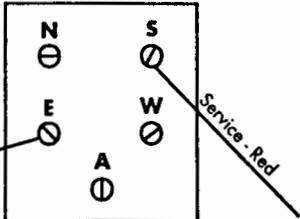
	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>93'</u>			
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>5'</u>	<u>10-12-94</u>		
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>88'</u>			

ENTERS: 1226 N Highland BRANCHED INTO:  
TAP SIZE: 1/2 PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION \_\_\_\_\_

PRESSURE TEST: @ 105 PSI FOR 14 HRS. BY EP  
MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1990  
DEPTH: 3 FT. 0 IN. LOCATION \_\_\_\_\_

"A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

	Test Station		
	Reading & Location	Lead	Volts
	P/S Pipeline Lead - Red New Service	<u>S</u>	<u>195/12</u>
	P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY