

LOCATION 308 & 302 Hillcrest st CITY Gastonia

BETWEEN M<sup>e</sup> Corner STREET & Dead End STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>3'</u>	<u>2-14-98</u>	<u>They over 190' 7/4 P.</u>	
MAIN TO PROP. LINE					<u>Sev. to new 2" P</u>	
PROP. LINE TO BLDG.					<u>main</u>	

ENTERS: 302 BRANCHED INTO: 302

TAP SIZE: 1/2 PRESSURE \_\_\_\_\_ PSI \_\_\_\_\_ INCHES W.C. LOCATION 12' N. of cor

Hillcrest


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY [Signature]

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ✓ YEAR INSTALLED 1997

DEPTH: 3 FT. 0 IN. LOCATION \_\_\_\_\_

"A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:

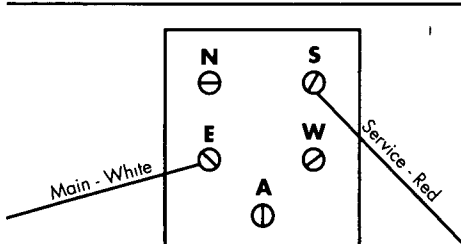

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>R</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY