

LOCATION 407 Hillcrest CITY Cambridge
BETWEEN St. Mark STREET & McArthur STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>10'</u>	<u>Tied over 50' of Ekt 3/4 plastic</u>		
MAIN TO PROP. LINE				<u>to Ekt 2" Plastic main</u>		
PROP. LINE TO BLDG.					<u>2-26-98</u>	


ENTERS: 407 BRANCHED INTO: 409
TAP SIZE: 3/4 PRESSURE 60 PSI _____ INCHES W.C. LOCATION _____

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY ED
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1998

DEPTH: 3 FT. 6 IN. LOCATION _____

"A" P/S READING P TOTAL ANODES 1# _____ 17# _____ L.R. # _____

REMARKS:

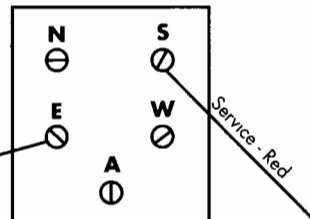

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Plastic</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY