

LOCATION 1006 Holland Ave. CITY East.  
BETWEEN Mauvey STREET & RANSOM STREET

|                     | SIZE          | TYPE     | LENGTH     | INSTALLED | RETIRED    | RENEWED    |
|---------------------|---------------|----------|------------|-----------|------------|------------|
| MAIN TO BLDG.       | <u>3 1/4"</u> | <u>P</u> | <u>80'</u> |           | <u>9-5</u> | <u>-96</u> |
| MAIN TO PROP. LINE  | <u>"</u>      | <u>"</u> | <u>40'</u> |           |            |            |
| PROP. LINE TO BLDG. | <u>"</u>      | <u>"</u> | <u>40'</u> |           |            |            |

ENTERS: 1006 BRANCHED INTO:  
TAP SIZE: 3 1/4" PRESSURE 60 PSI \_\_\_\_\_ INCHES W.C. LOCATION E of 1006


PRESSURE TEST: @ 100 PSI FOR 1 1/4 HRS. BY GK

MAIN-SIZE 2 C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC - YEAR INSTALLED 96

DEPTH: 3 FT. IN. \_\_\_\_\_ LOCATION 5 side of Holland

"A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

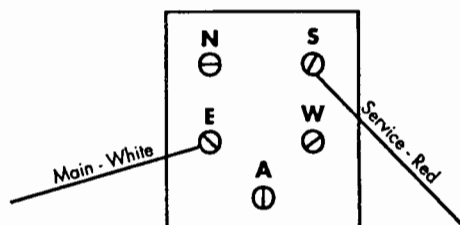

| Test Station                            |          |          |
|---|----------|----------|
| Reading & Location                      | Lead     | Volts    |
| P/S Pipeline Lead - Red New Service     | <u>S</u> | <u>7</u> |
| P/S Pipeline Lead - White Existing Main | <u>E</u> |          |

ENG. DEPT. USE ONLY