

LOCATION 1015 Holly Hills Dr. CITY BARTONIA
BETWEEN Chapel Grove Rd. STREET & Locust Ct. STREET


	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>PLASTIC</u>	<u>94'</u>	<u>2-18-98</u>		
MAIN TO PROP. LINE	<u>3/4</u>	<u>PLASTIC</u>	<u>20'</u>			
PROP. LINE TO BLDG.	<u>3/4</u>	<u>PLASTIC</u>	<u>74'</u>			

ENTERS: 1015 BRANCHED INTO: 0
TAP SIZE: 3/8 PRESSURE 60 PSI _____ INCHES W.C. LOCATION 290' W of Cor Locust Ct.

PRESSURE TEST: @ 100 PSI FOR 44 HRS. BY RL
MAIN-SIZE 2" C.I. _____ BARE STEEL _____ COATED STEEL ☒ PLASTIC _____ YEAR INSTALLED 1971
DEPTH: 3 FT. 0 IN. LOCATION 15' S of Cor Holly Hills Dr.

"A" P/S READING 104 TOTAL ANODES 1# _____ 17# 1 L.R.# 106293

REMARKS:

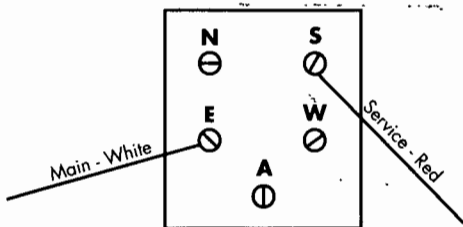

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>Riser</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	<u>PLASTIC</u>

ENG. DEPT. USE ONLY