

LOCATION 3647 Jordanview Ln CITY Oakton

BETWEEN Bryant Cole way STREET & Bryant Cole way STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>80'</u>	<u>9-28-95</u>		
MAIN TO PROP. LINE	<u>1/1</u>	<u>11</u>	<u>9'</u>			
PROP. LINE TO BLDG.	<u>1/4</u>	<u>11</u>	<u>71'</u>			

ENTERS: 3647 BRANCHED INTO: —

TAP SIZE: \_\_\_\_\_ PRESSURE \_\_\_\_\_ P.S.I. \_\_\_\_\_ INCHES W.C. LOCATION 17' W. of cap

\_\_\_\_\_ Jordanview Ln


PRESSURE TEST: @ 100 psi For 1/4 Hrs. By [Signature]

MAIN-SIZE 2" C.I. \_\_\_\_\_ BARE STEEL \_\_\_\_\_ COATED STEEL \_\_\_\_\_ PLASTIC ☒ YEAR INSTALLED 1992

DEPTH: 3 Ft. 0 In. LOCATION \_\_\_\_\_

"A" P/S READING P TOTAL ANODES 1# \_\_\_\_\_ 17# \_\_\_\_\_ L.R. # \_\_\_\_\_

REMARKS: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

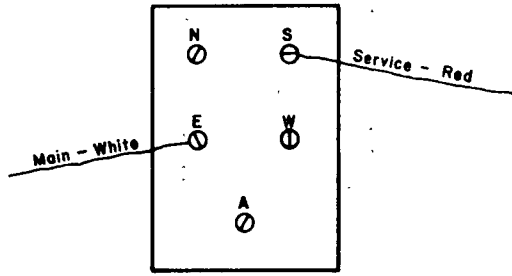

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>R</u>	<u>P</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY