

LOCATION 301 1/2 KickapooCITY CamptonBETWEEN FallsSTREET & Carier

STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG.	<u>3/4</u>	<u>P</u>	<u>141'</u>		<u>X</u>	
MAIN TO PROP. LINE	<u>3/4</u>	<u>P</u>	<u>01'</u>			<u>3-10-98</u>
PROP. LINE TO BLDG.	<u>3/4</u>	<u>P</u>	<u>141'</u>			


ENTERS: No #BRANCHED INTO: 301 1/2TAP SIZE: 3/4 Ser.PRESSURE 60 PSI

INCHES W.C.

LOCATION

PRESSURE TEST: @ 100 PSI FOR 1/4 HRS. BY EDMAIN-SIZE 3/4 C.I. BARE-STEEL COATED STEEL ✓ PLASTIC YEAR INSTALLED 1981DEPTH: 2 FT. 0 IN. LOCATION "A" P/S READING 1.2TOTAL ANODES 1# 117# 0L.R. #

REMARKS:

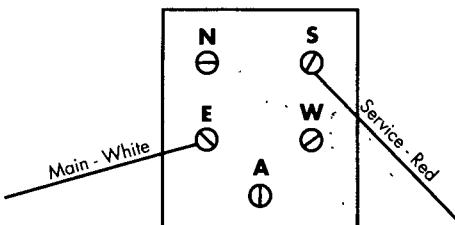

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	<u>S</u>	<u>0.15</u>
P/S Pipeline Lead - White Existing Main	<u>E</u>	

ENG. DEPT. USE ONLY