

LOCATION 1141 Laurel Woods Dr. CITY Gastonia

BETWEEN Graywood Dr. STREET & shady OAK TRL STREET

	SIZE	TYPE	LENGTH	INSTALLED	RETIRED	RENEWED
MAIN TO BLDG	<u>3/4"</u>	<u>P</u>	<u>120'</u>	<u>11/7/00</u>		
MAIN TO PROP LINE	<u>3/4"</u>	<u>P</u>	<u>45'</u>	<u>"</u>		
PROP LINE TO BLDG	<u>3/4"</u>	<u>P</u>	<u>75'</u>	<u>"</u>		

ENTERS 1141 Laurel Woods Dr. BRANCHED INTO Ø

TAP SIZE 1/2" PRESSURE 60 PSI _____ INCHES W C LOCATION 126' west of center of crowder woods Dr.


PRESSURE TEST: @ 100 PSI FOR 1/4 HRS BY D. Woody

MAIN-SIZE 2" C I _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1999

DEPTH 3' FT 0" IN LOCATION 20' south of center of Laurel woods Dr.

"A" P/S READING 7/1A TOTAL ANODES 1# 0 17# 0 I.R. # 01003248

REMARKS new plastic 1/2 service

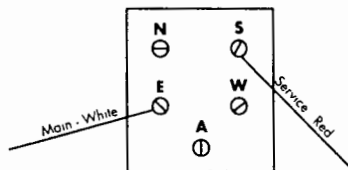

Test Station		
Reading & Location	Lead	Volts
P/S Pipeline Lead - Red New Service	S	plastic
P/S Pipeline Lead - White Existing Main	E	riser