

LOCATION 612 Linwood Rd CITY Davenport
 BETWEEN Spencer STREET & US 2 STREET

| | SIZE | TYPE | P LENGTH S | INSTALLED | RETIRED | RENEWED |
|---------------------|------|------|------------|----------------------|---------|---------|
| MAIN TO BLDG. | 3/4 | | 50 0 | Trid over 6-20-77 | | |
| MAIN TO PROP. LINE | 3/4 | | 50 60 | | | |
| PROP. LINE TO BLDG. | 3/4 | | 0 60 | | | |

ENTERS: 612 BRANCHED INTO:
 TAP SIZE: 1/2 PRESSURE _____ P.S.I. _____ INCHES W.C. LOCATION Inside of Bldg

PRESSURE TEST: @ 100 psi For 1/4 Hrs. By J. Bennett


MAIN-SIZE 4 C.I. _____ BARE STEEL _____ COATED STEEL _____ PLASTIC ✓ YEAR INSTALLED 1953

DEPTH: 2 Ft. 6 In. LOCATION 25' W of Bldg

"A" P/S READING -90 TOTAL ANODES 1* _____ 17* _____ L.R. # _____

REMARKS: Ins Pressure was removed

**Bare Main Replacement
Program**

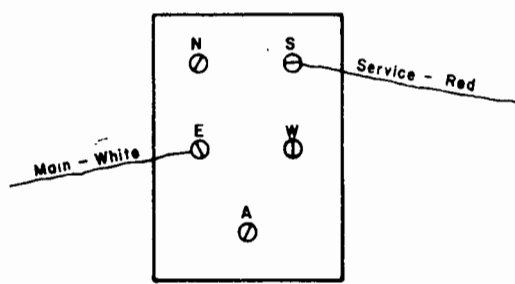

| Test Station | | |
|--|------|-------|
| Reading & Location | Lead | Volts |
| P/S Pipeline Lead - Red New Service | S | 100 |
| P/S Pipeline Lead - White Existing Main | E | |

ENG. DEPT. USE ONLY